


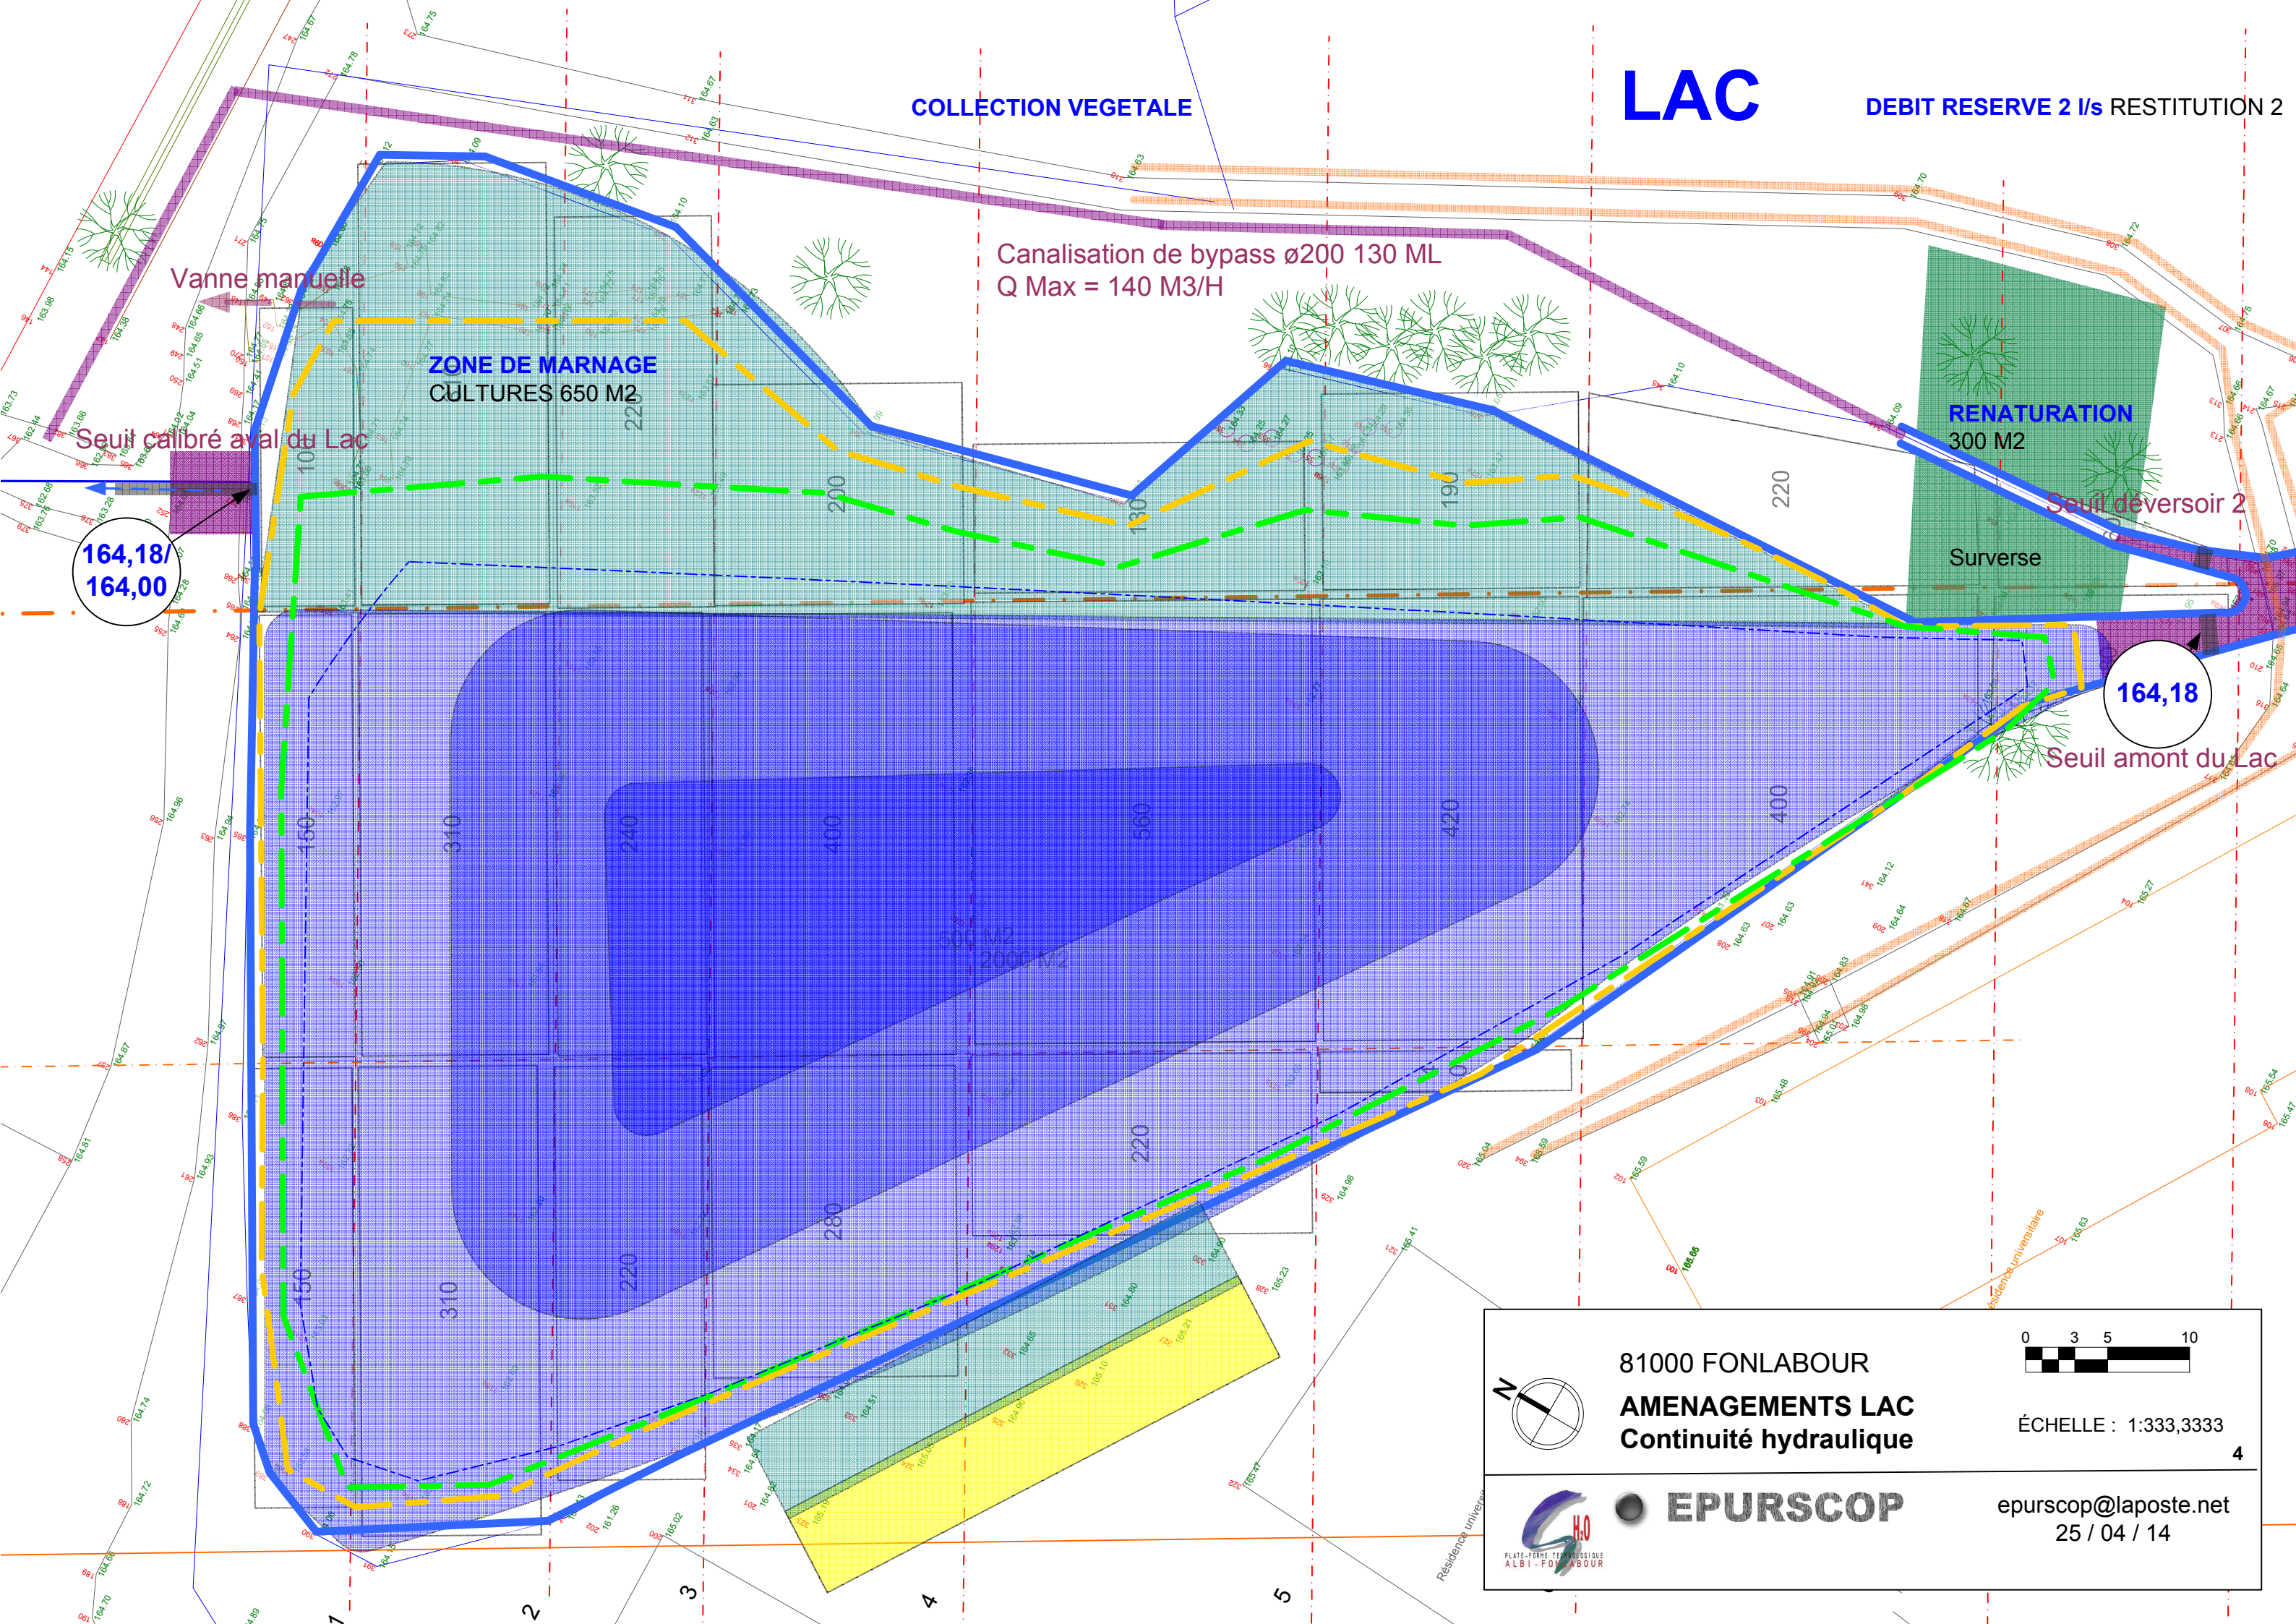

LAC

DEBIT RESERVE 2 l/s RESTITUTION 2

COLLECTION VEGETALE

Canalisation de bypass ø200 130 ML
Q Max = 140 M3/H

Vanne manuelle

ZONE DE MARNAGE
CULTURES 650 M2

RENATURATION
300 M2

Seuil calibré aval du Lac


164,18/
164,00

Surverse

Seuil deversoir 2

164,18

Seuil amont du Lac



81000 FONLABOUR
AMENAGEMENTS LAC
Continuité hydraulique



ÉCHELLE : 1:333,3333



EPURSCOP

epurscop@laposte.net
25 / 04 / 14