



AMONT

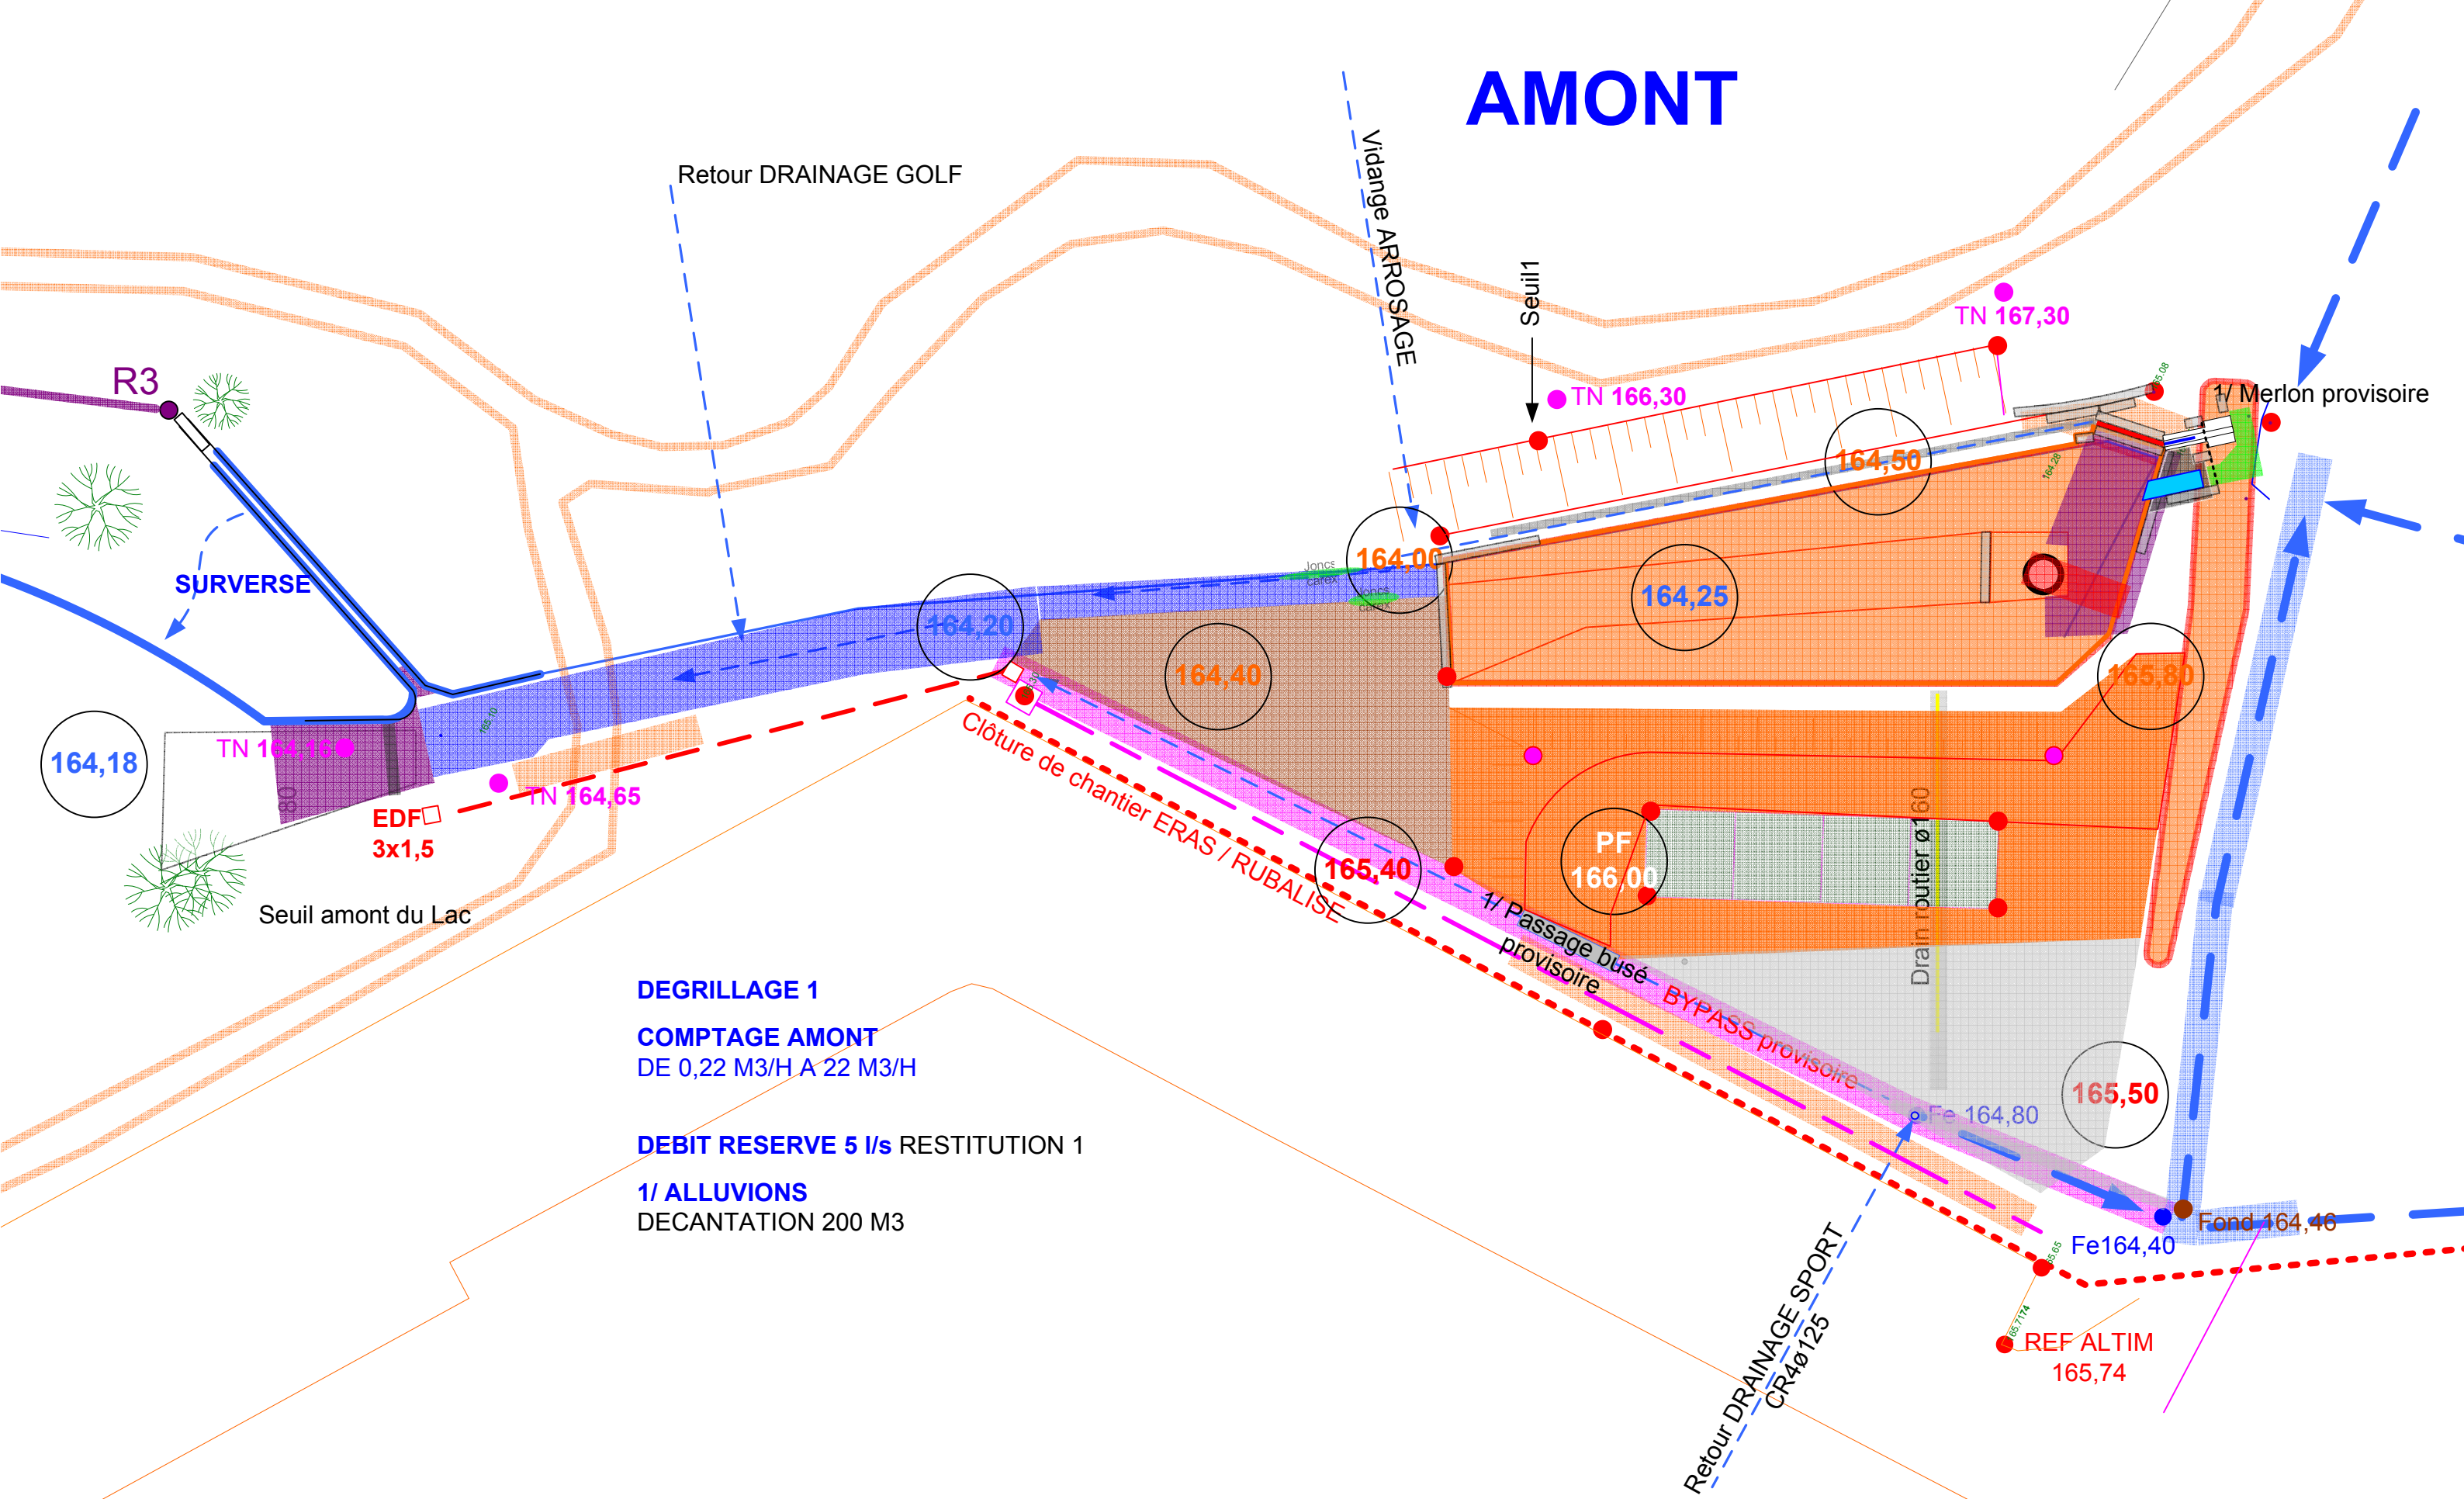

DEGRILLAGE 1
COMPTAGE AMONT
DE 0,22 M3/H A 22 M3/H

DEBIT RESERVE 5 l/s RESTITUTION 1
1/ ALLUVIONS
DECANTATION 200 M3



81000 FONLABOUR
AMONT PHASE1
DEBLAI-REMBLAI



ÉCHELLE : 1:333,3333



epurscop@laposte.net 12 / 04 / 17